



CLIENT: Kuan Show International Corporation  
6F-1, Number 5, Lane 271  
Nong An Street  
Taipei, Taiwan, R.O.C.

Test Report No: 628457-02

Date: June 16, 2006

The following sample was submitted by the Client as: PVC Ceiling Gypsum Board

DATE OF RECEIPT: May 26, 2006

TESTING PERIOD: June 14, 2006

AUTHORIZATION: Order Confirmation Number 628457, dated May 30, 2006

TEST REQUESTED: The submitted sample was tested for Surface Burning Characteristics in accordance with the procedures outlined in ASTM E84-05.

TEST RESULTS: Continued on the following pages

PREPARED BY:

*William G. Booth*  
William G. Booth, Technician  
Fire Technology

SIGNED FOR AND ON BEHALF OF  
SGS U.S. TESTING COMPANY INC.

*Arthur D. Fiorino*  
Arthur D. Fiorino, Senior Technician  
Fire Technology

Page 1 of 3

CLIENT: Kuan Show International Corporation

## RESULTS:

### INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Values per ASTM E-84-05. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The tests were performed in accordance with the specifications set forth in ASTM E-84-05, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedure. This test procedure is similar to UL-723, ANSI No. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during a 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100, respectively.

### PREPARATION AND CONDITIONING:

Twelve (12) pieces of sample supplied by the client was placed into the fire chamber end to end to form a 21 inch wide X 24 foot long specimen for testing. The samples were placed over screen and rods for support. Inorganic cement boards were placed over the sample prior to testing as a means of protecting the interior of the tunnel lid.

The sample was conditioned at  $73^{\circ} \pm 5^{\circ}$  Fahrenheit and  $50 \pm 5\%$  relative humidity.

### TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed  $105^{\circ}$  Fahrenheit  $\pm 5^{\circ}$  Fahrenheit level, the sample was inserted in the tunnel and test conducted in accordance with the standard ASTM E-84-05 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board on the day of the test.

CLIENT: Kuan Show International Corporation

**RESULTS:**

**TEST RESULTS:**

The test results, calculated in accordance with ASTM E-84-05 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen	: PVC Ceiling Gypsum Board
Flame Spread Index*	: 5
Smoke Developed Value*	: 5

\*Rounded off to the nearest 5 units. Graphs of the Flame Spread, Smoke Developed and Time-Temperature are shown on the attached charts at the end of this report.

**OBSERVATIONS:**

Ignition occurred at 50-seconds. The following observations were noted:

- Charring

**RATING:**

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84).

The classifications are as follows:

Class A Interior Wall & Ceiling Finish:	Flame Spread - 0-25
	Smoke Developed - 0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread - 26-75
	Smoke Developed - 0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread - 76-200
	Smoke Developed - 0-450

Since the sample received a Flame Spread of 5 and a Smoke Developed Value of 5, it would meet the parameters for a Class A Interior Wall & Ceiling Finish Category.


\*\*\*\*\*

End of Report




Client: Kuan Show International Corporation  
Report No: 628457-2  
Sample ID: PVC Ceiling Gypsum Board

## Flame Spread Chart

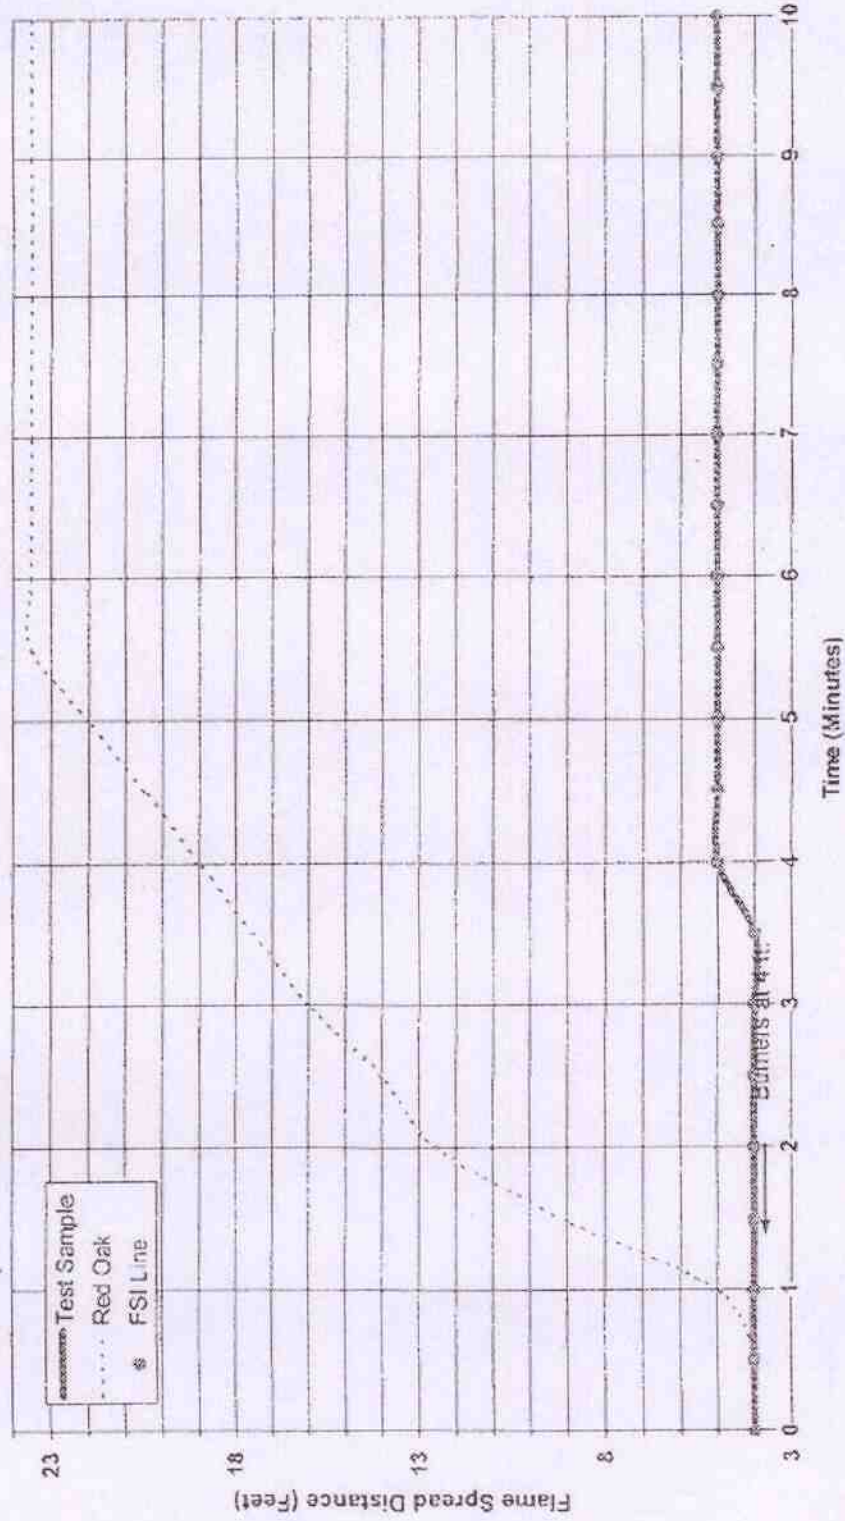

Client: Kuan Show International Corporation  
Report No: 628457-2  
Sample ID: PVC Ceiling Gypsum Board

## Smoke Developed Chart

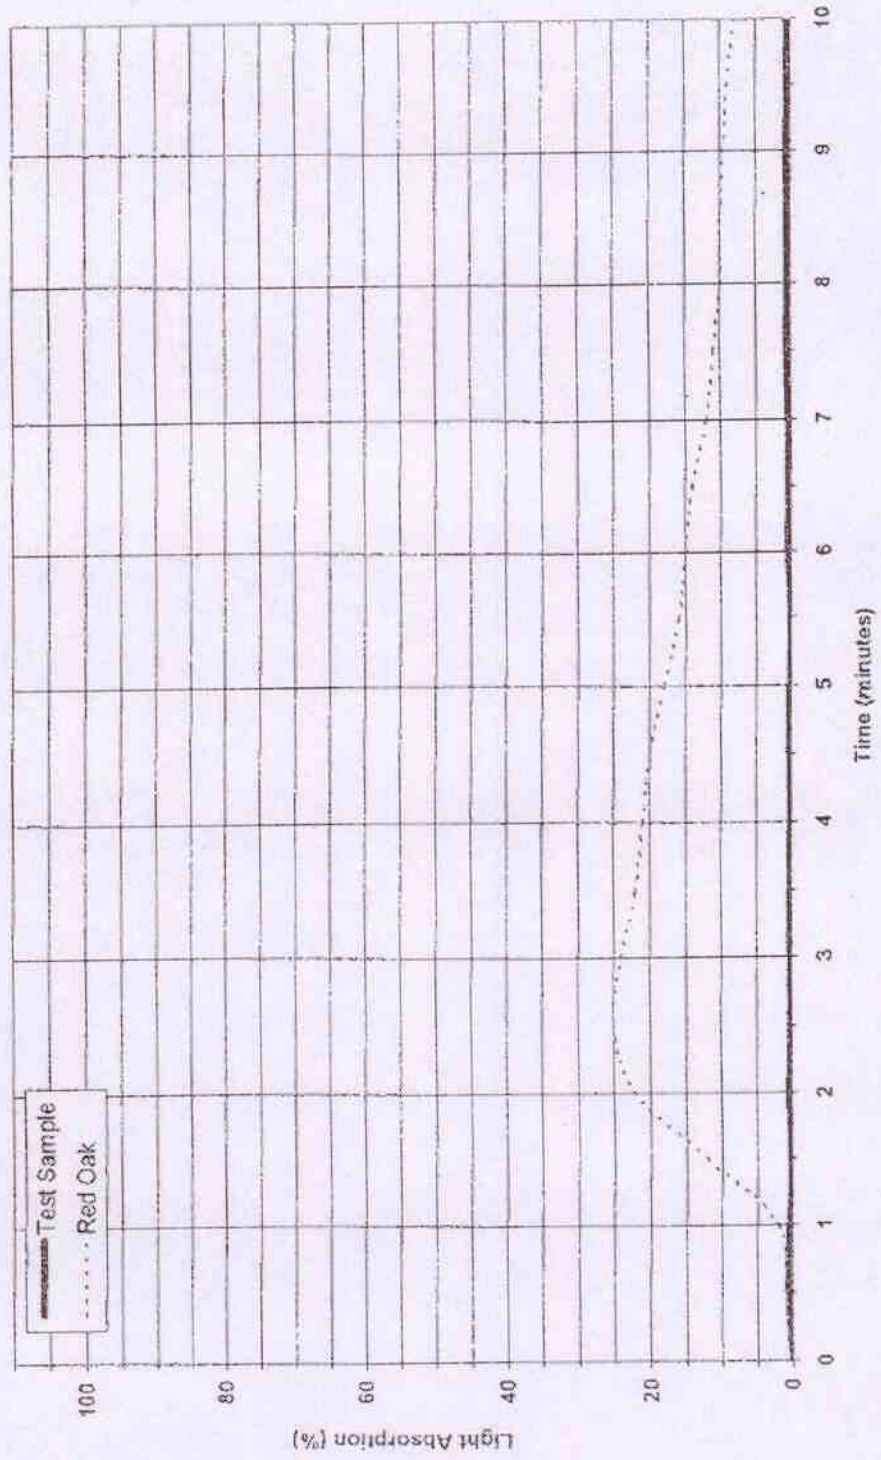

Client: Kuan Show International Corporation  
Report No: 628457-2  
Sample ID: PVC Ceiling Gypsum Board

## Temperature - Time Curve

